


PLAN

- (A) OUTSIDE STEM AND YOKE GATE VALVE
- (B) DOUBLE CHECK VALVE ASSEMBLY
- (C) OUTSIDE STEM AND YOKE GATE VALVE
- (D) JD-2AL 4' x 4' BILCO DOOR, OR AS MANUFACTURED BY VA. SPRINKLER COMPANY, OR APPROVED EQUAL.
- (E) SUMP PUMP OR GRAVITY DRAIN REQUIRED.

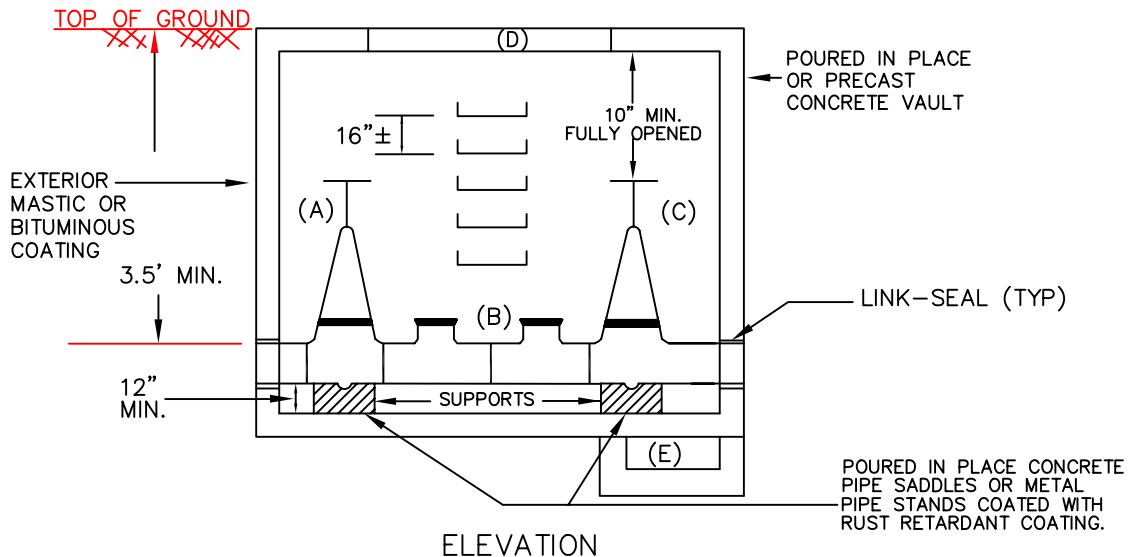

ELEVATION

DATE
MAY 2004
HANOVER
DPU

SYSTEM INTERCONNECTION 3" OR LARGER
DOUBLE CHECK ASSEMBLY & VAULT - 3 OF 3

DRWG. NO.
FIR-7