


ASPHALT CONCRETE
TYPE SM-2A
165 LBS. PER SQ. YD.

PLANT MIX MINIMUM OF
12" BM-2 (BASE MIX)

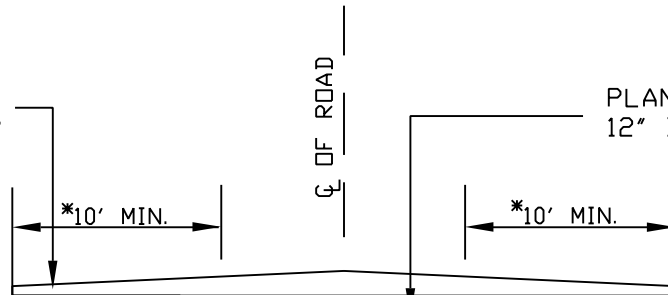

10"-AGGREGATE MATERIAL
TYPE 1, SIZE 21A OR 21B.

TACK COAT 0.05-0.15 GAL. SHALL
CONFORM TO THE REQUIREMENTS OF
AASHTO M208 PER SQ. YD. (EACH SIDE).

CREATE A 12" BENCH (EACH
SIDE) MINIMUM.

SELECT BACKFILL COMPACTED TO 95% MAX.
DENSITY FOR PROJECTS THAT INCLUDE
PARALLEL INSTALLATIONS AND SEWER
SERVICE CROSSINGS, OR 21 OR 21A
AGGREGATE BACKFILL COMPACTED TO 95%
MAX. DENSITY WHERE ONLY INDIVIDUAL
SEWER LINE/LATERAL CROSSINGS ARE
PROPOSED.

PROPOSED SEWER LINE.

57 STONE BEDDING AND
BACKFILL (TYPICALLY REQD.
FOR PVC PIPE).



MIN. TRENCH WIDTH TO
SUPPORT TRENCH BOX.

* REPLACEMENT OF PAVEMENT SHALL BE FROM
EDGE OF PAVEMENT TO EDGE OF PAVEMENT.

NOTE: SEE PAV-5 FOR ALTERNATIVE METHOD FOR REPLACING PAVEMENT.

DATE
MAY 2004
HANOVER
DPU

TYPICAL SECTION FOR REPAIR OF OPEN CUT AFTER
PLACEMENT OF SEWER IN PLANT MIX ROADS
(APPLIES TO PARALLEL INSTALLATIONS AND CROSSINGS)

DRWG. NO.
PAV-5
SHT. 2 OF 2